


HOLDRITE HydroFlame

Date: 11/02/2007

INSULATION TERMINATED AT CORRUGATED DECK

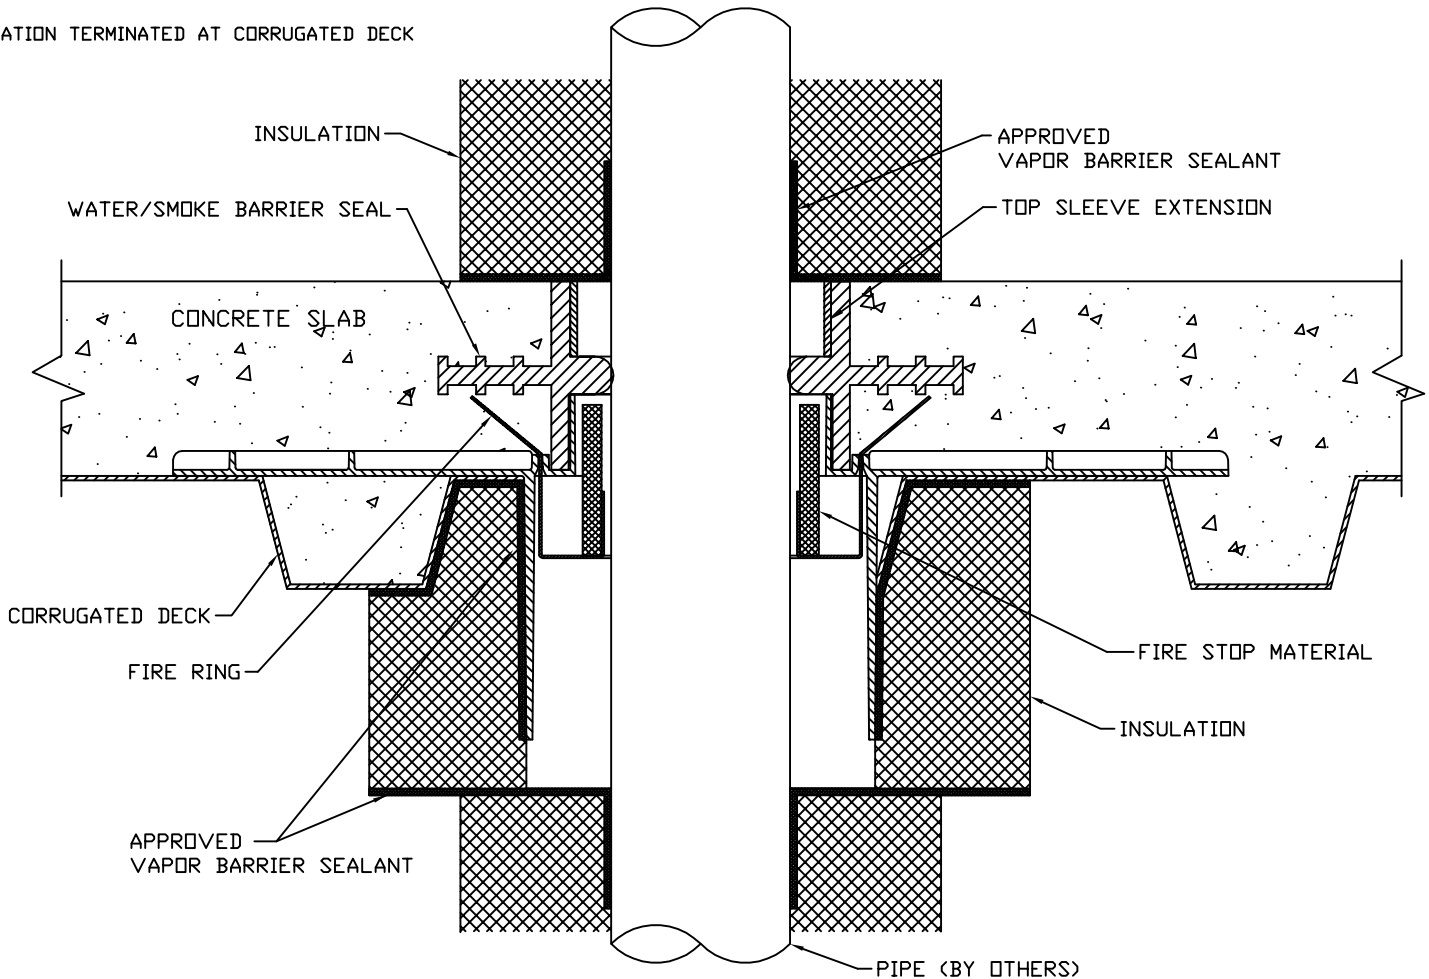

(15) Corrugated Floor, Water/Air/Smoke Tight Sleeve, B&W Detail

Water/Air/Smoke tight pass-through device, Hydroflame, for metallic pipes only, passing through concrete floor, over metal deck, with insulation. No additional caulk or mineral wool required. Sealant is required only for maintaining a vapor barrier and is not necessary for piping where a vapor barrier is not required. Sealant is used in lieu of passing the insulation completely through the sleeve. The sealant is an insulation-compatible vapor barrier sealant, as recommended by the manufacturer of the insulation.